



TOP VIEW

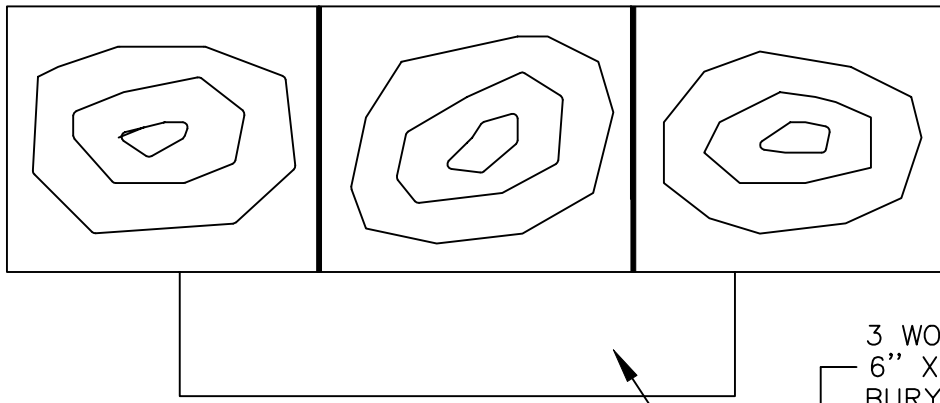

3 WOLMANIZED CCA
6" X 6" TIES
BURY 24" MINIMUM

SIDE VIEW

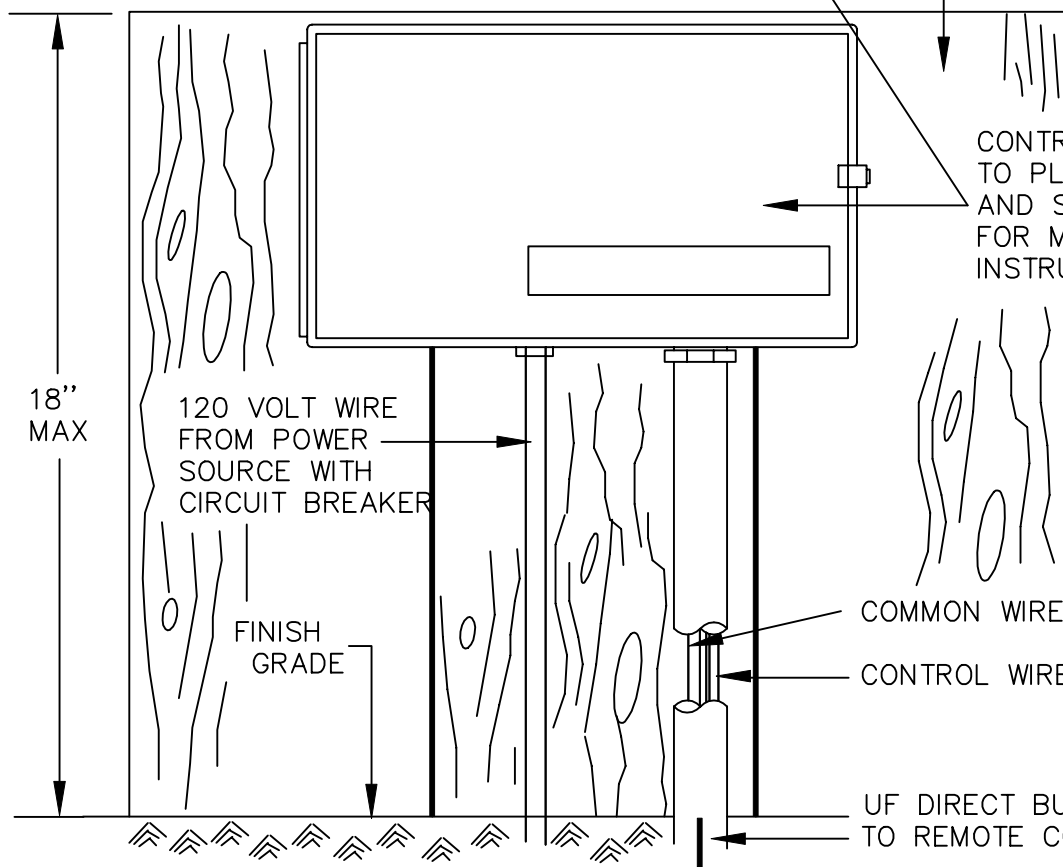

CONTROLLER - REFER TO PLANS FOR MODEL AND SPECIFICATIONS FOR MOUNTING INSTRUCTIONS

18" MAX

120 VOLT WIRE FROM POWER SOURCE WITH CIRCUIT BREAKER

FINISH GRADE

COMMON WIRE

CONTROL WIRE

UF DIRECT BURIAL WIRES TO REMOTE CONTROL VALVES

NOTES:

1. ALL WIRING TO BE INSTALLED AS PER CODE AND BY A LICENSED ELECTRICIAN.
2. POWER SHALL BE PROVIDED AS PER THE SPECIFICATIONS. LOCATE CONTROLLER WHERE SHOWN ON THE PLANS.

DRAWN BY: JSH
CHECKED BY: WGH

APPROVED BY:
DIRECTOR OF PUBLIC WORKS

CITY OF BOULDER, COLORADO
IRRIGATION SYSTEM
CONTROLLER

ISSUED: JULY 2, 1998
REVISED: OCT. 17, 2000

DRAWING NO.
3.41