


#2 SHUTOFF VALVE CLOSED DURING BLOWOUT OPERATION

FEBCO #765 "PRESSURE VACUUM BREAKER" FOR ABOVE GROUND INSTALLATION. SEE PLAN FOR SIZE

NOTE: ALL BACKFLOW PREVENTION DEVICES SHALL BE APPROVED MODELS ONLY, REFER TO SECTION 5.11.09 "BACKFLOW PREVENTION DEVICES". ALL PIPE FROM CONNECTION TO EXISTING SERVICE THRU VACUUM BREAKER ASSEMBLY TO MAIN LINE SHALL BE TYPE "K" HARD COPPER, ALL FITTINGS AND NIPPLES SHALL BE RED BRASS.

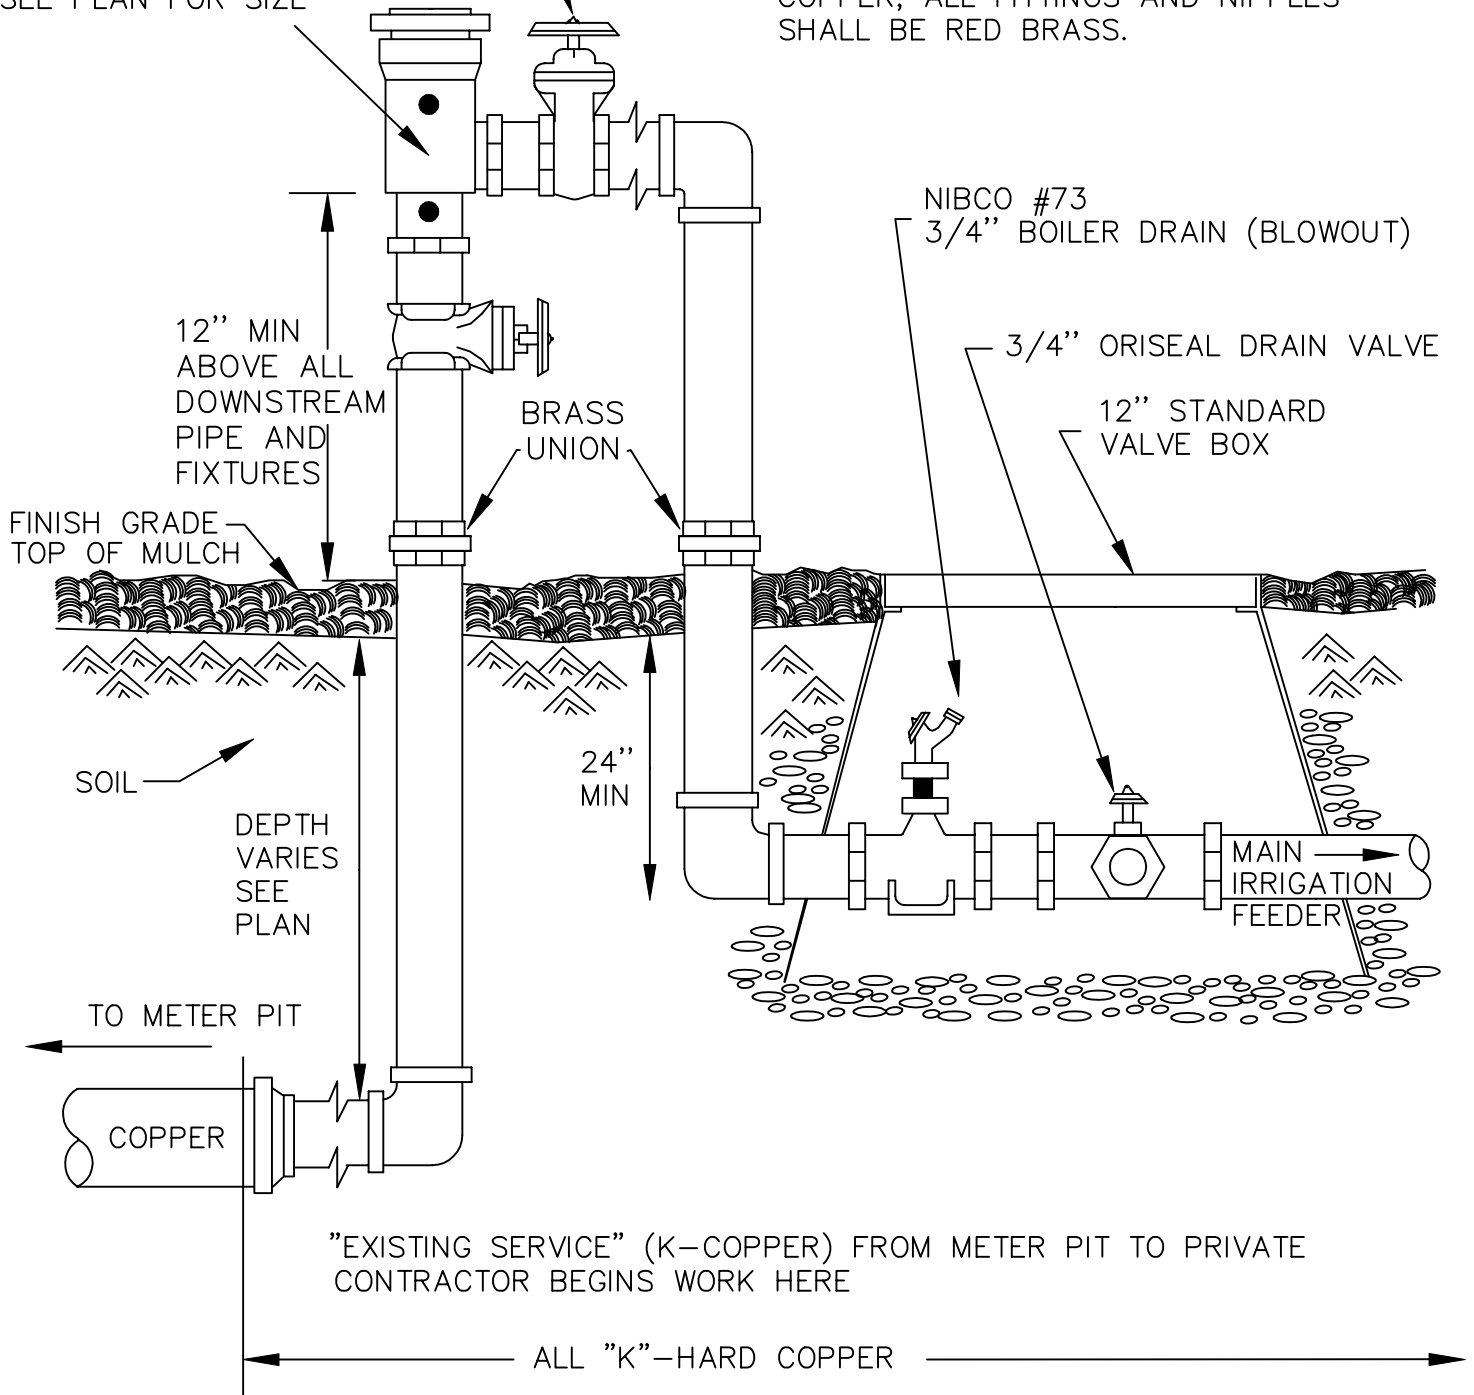

DRAWN BY: JSH

CHECKED BY: WGH

APPROVED BY:  
DIRECTOR OF PUBLIC WORKS

CITY OF BOULDER, COLORADO  
IRRIGATION PRESSURE  
VACUUM BREAKER

ISSUED: JULY 2, 1998  
REVISED: OCT. 17, 2000

DRAWING NO.  
3.21