
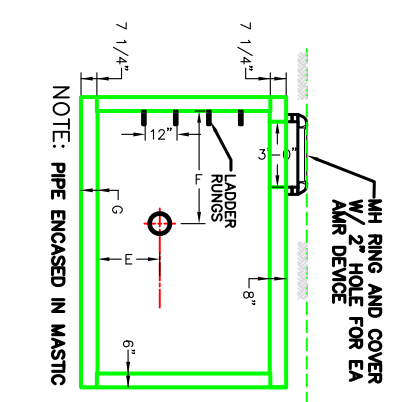


SECTION A
THIS SHIT

SECTION B
THIS SHIT

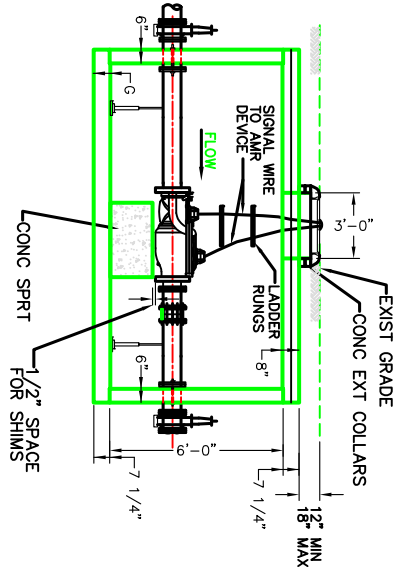

NOTE: PIPE ENCASED IN MASTIC

- NOTES:
1. THE ROOF SLAB MAY BE CAST IN SECTIONS FOR FUTURE ACCESS THE INDIVIDUAL SECTION WEIGHT MUST NOT EXCEED 7,500 POUNDS ACCORDING TO MS-26.
 2. THE DISTANCE BETWEEN RUNGS, CLEATS AND STEPS SHALL NOT EXCEED 12 INCHES AND SHALL BE UNIFORM THROUGHOUT THE LENGTH OF THE LADDER.
 3. EACH METER REGISTER REQUIRES AN ELECTRONIC DIGITAL ENCODER OR MECHANICALLY ENCODED REGISTER WITH AMR DEVICES EXCEPT FOR MASTER METER DISTRIBUTORS. THE CITY OF BOULDER WILL DETERMINE TYPE OF AMR DEVICES AND LOCATION PRIOR TO VAULT INSTALLATION.
 4. ALL VALVES MUST BE NON RISING STEM RIGHT HAND OPEN VALVES.
 5. ALL PIPING MUST HAVE STEEL PIPE SUPPORTS.

NOTE:
VAULTS ARE PRECAST TO DIMENSION IN CHART

METER SIZE	BP SIZE	PRECAST VAULT DIMENSIONS	SUMP						
		C	D	E	F	G	H	I	J
6"OR<	4"	10'-6"	8'-0"	2'-0"	2'-6"	6"	12"	2'-2"	1'-6"

CITY OF BOULDER, COLORADO
LARGE METER IN
PRECAST VAULT
6" OR LARGER

DRAWN BY: DK
CHECKED BY: RJH
APPROVED BY: DIRECTOR OF PUBLIC WORKS

ISSUED: JULY 2, 1998
REVISED: JUNE 1, 2019

DRAWING NO.
5.18B