


PLACEMENT OF METER PIT SHALL BE 3' FROM CENTERLINE OF LID TO BACK EDGE OF CURBWALK OR IF SIDEWALK IS SEPARATE FROM CURB, METER PIT SHALL BE INSTALLED ON STREET SIDE OF WALK 3' FROM FRONT SIDE OF WALK

METER AND LID WITH 36" FLANGE. SHALL BE INSTALLED AND MAINTAINED LEVEL WITH THE ADJACENT GROUND

SEE DRAWING NO. 5.18D FOR ADJUSTMENT DETAIL, IF REQUIRED

SEE DRAWING NO. 5.18B FOR PLAN VIEW

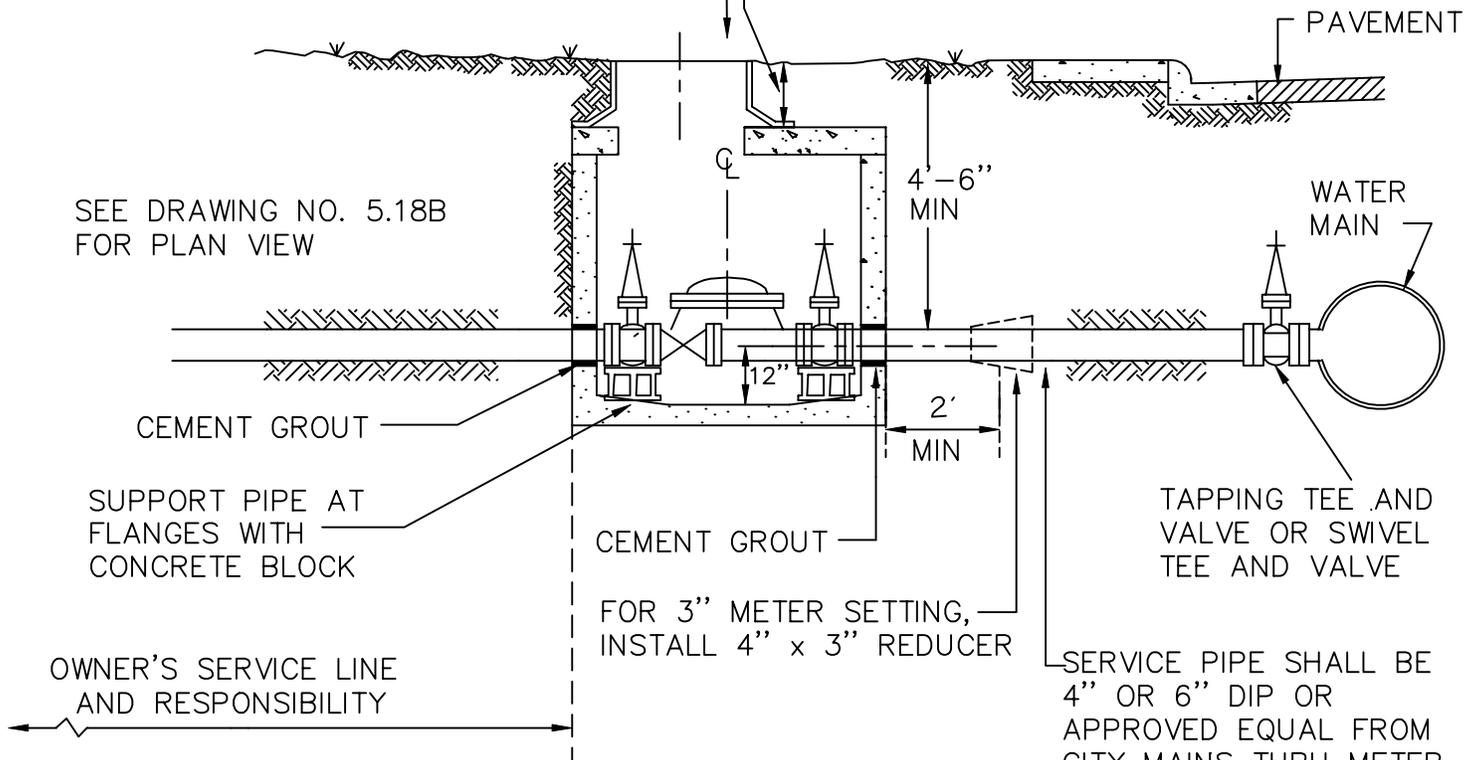

PROFILE

SERVICE PIPE SHALL BE 4" OR 6" DIP OR APPROVED EQUAL FROM CITY MAINS THRU METER PIT. SERVICE PIPE FOR 3" METER SETTING SHALL BE 4" FROM WATER MAIN TO REDUCER

NOTES:

1. SHOULD ANY SITUATION ARISE OTHER THAN SHOWN CONCERNING THE DEPTH OR OBSTRUCTION OF SERVICE LINE OR THE PLACEMENT OF METER PIT, CALL CITY OF BOULDER ROW INSPECTOR.
2. METER TO PLACED IN PUBLIC ROW OR EASEMENT. DO NOT PLACE IN SIDEWALK OR DRIVE.
3. ALL BYPASS VALVES TO BE LOCKED CLOSED.
4. METER, MONITOR COVER WITH FLANGE, RISER AND LID SHALL BE PURCHASED FROM CITY OF BOULDER.

DRAWN BY: JSH

CHECKED BY: RJH

APPROVED BY:  
DIRECTOR OF PUBLIC WORKS

CITY OF BOULDER, COLORADO  
STANDARD  
3" AND 4"  
SERVICE

ISSUED: JULY 2, 1998

REVISED: OCT. 17, 2000

DRAWING NO.

5.18A