


NOTES:

1. SHOULD ANY SITUATION ARISE OTHER THAN SHOWN CONCERNING THE DEPTH OR OBSTRUCTION OF SERVICE LINE OR PLACEMENT OF METER PIT, CALL THE CITY OF BOULDER ROW INSPECTOR.
2. METERS TO BE PLACED IN PUBLIC ROW OR EASEMENT. DO NOT PLACE IN SIDEWALK OR DRIVE.
3. PLACEMENT OF METER PIT SHALL BE 2' FROM CENTERLINE OF LID TO BACK EDGE OF CURBWALK. IF SIDEWALK IS SEPARATE FROM CURB, METER PIT SHALL BE INSTALLED ON STREET SIDE OF WALK 2' FROM FRONT SIDE OF WALK.
4. METER, LID, VALVE & FITTINGS SHALL BE PURCHASED FROM THE CITY OF BOULDER.
5. METER SHALL BE INSTALLED BY CITY.
6. CORPORATION STOP AND DOUBLE STRAP BRONZE SERVICE SADDLE REQUIRED FOR PVC WATER MAINS.

LID FOR METER PIT SHALL BE INSTALLED AND MAINTAINED LEVEL WITH THE EXISTING GROUND IN A DEVELOPED AREA OR FUTURE GROUND LEVEL AS DETERMINED BY DEVELOPMENT GRADING PLAN

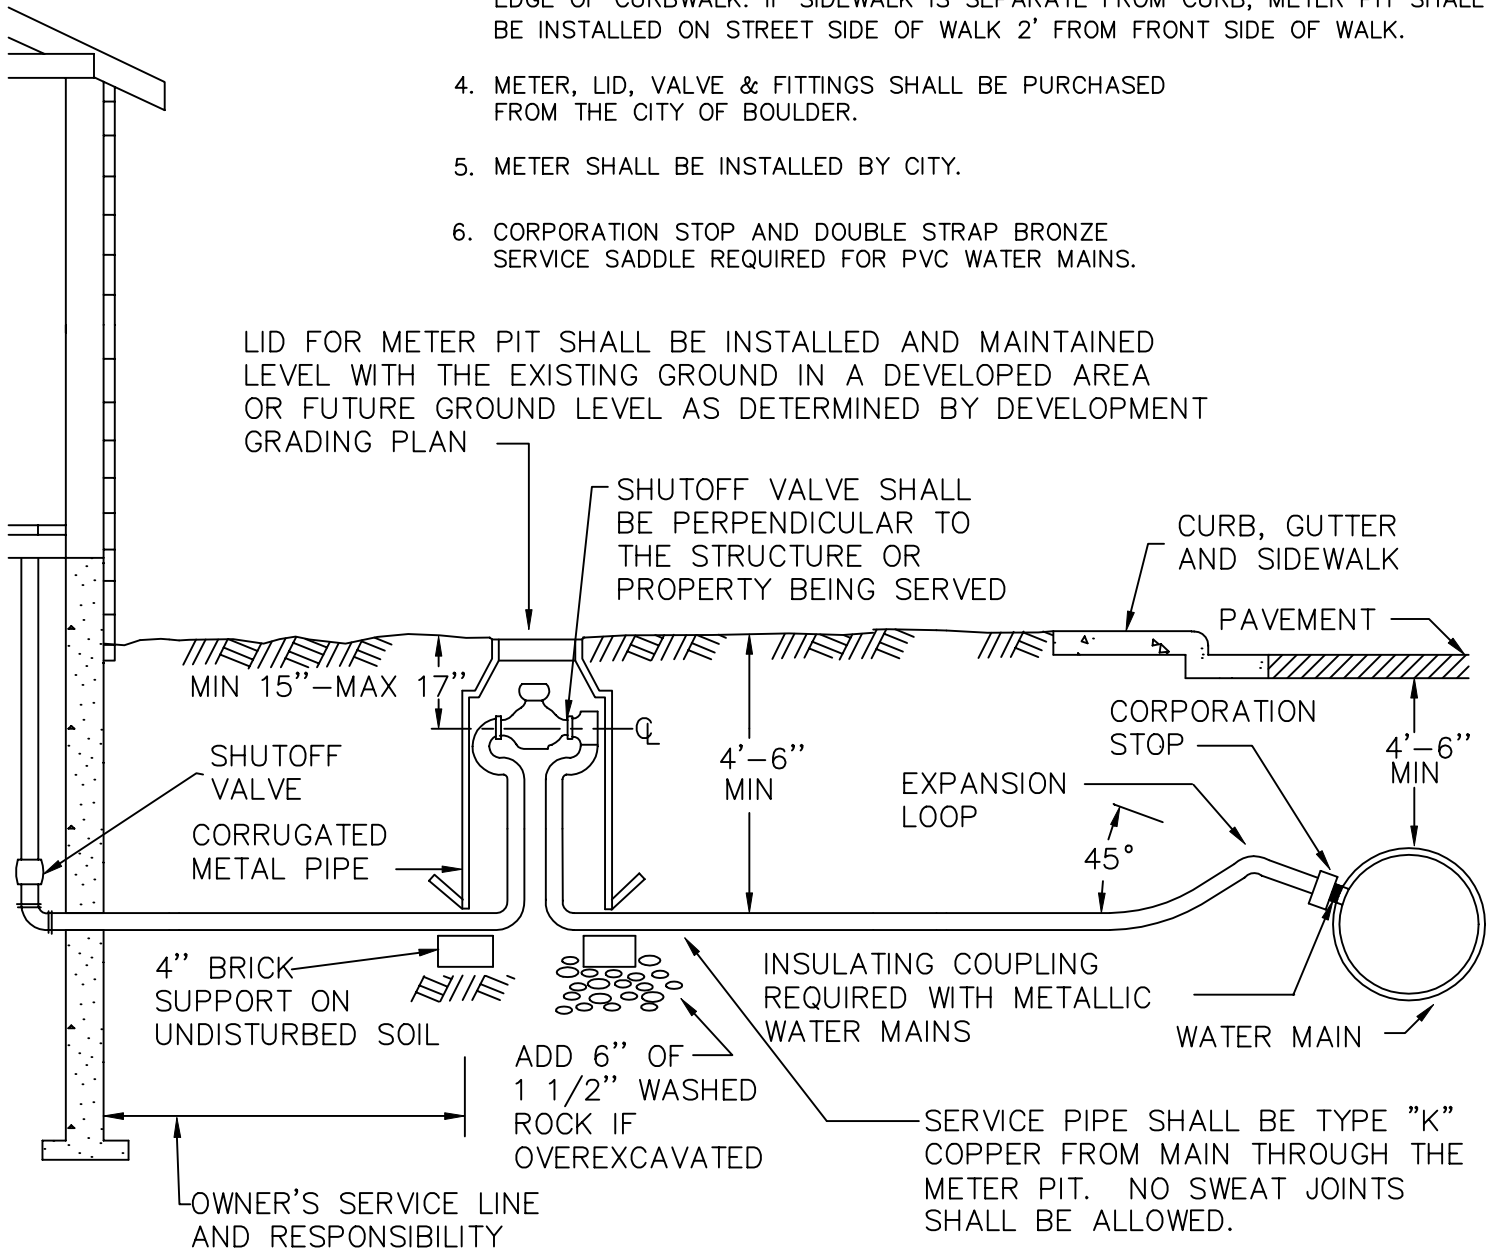

PROFILE

DRAWN BY: JSH

CHECKED BY: RJH

APPROVED BY:
DIRECTOR OF PUBLIC WORKS

CITY OF BOULDER, COLORADO

STANDARD
3/4" - 1" SERVICE

ISSUED: JULY 2, 1998

REVISED: OCT. 17, 2000

DRAWING NO.

5.16A