


NOTES:

1. ALL EXPOSED CONCRETE SHALL HAVE A BROOM FINISH.
2. EXPANSION JOINTS SHALL BE INSTALLED AT 500 FOOT MAXIMUM INTERVALS AND AT FIXED STRUCTURES (INLETS, BUILDINGS). SEE CONCRETE WALK AND MULTI-USE PATH JOINT DETAILS.
3. CONTRACTION JOINTS SHALL BE INSTALLED AT 5 FOOT INTERVALS OR INTERVALS EQUAL TO SIDEWALK WIDTH. SEE CONCRETE WALK AND MULTI-USE PATH JOINT DETAILS.
4. IF SIDEWALK IS PLACED ADJACENT TO CURB AND GUTTER, CONTRACTION JOINTS SHALL LINE UP WITH CURB AND GUTTER JOINTS.
5. LONGITUDINAL JOINTS ARE NOT ALLOWED IN CONCRETE WALK OR MULTI-USE PATH.

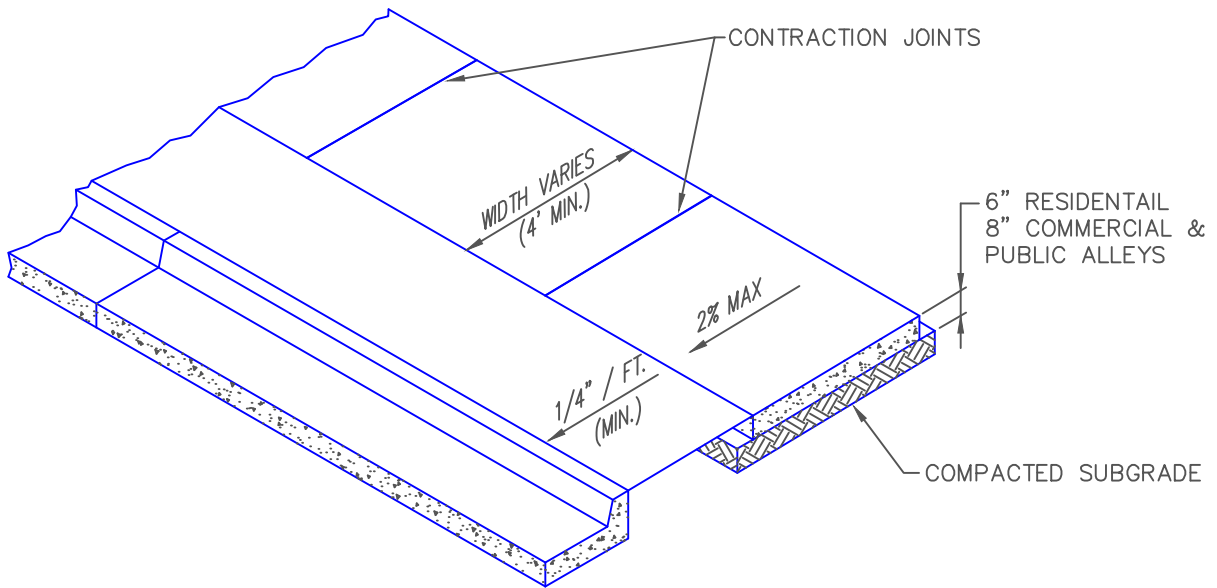

DRAWN BY: JSH  
CHECKED BY: WGH

APPROVED BY:  
DIRECTOR OF PUBLIC WORKS

CITY OF BOULDER, COLORADO

CONCRETE WALK AND  
MULTI-USE PATHS

ISSUED: JULY 2, 1998  
REVISED: OCT 6, 2009

DRAWING NO.

2.02.A